


FPS-1650 W/ OPTIONAL AIR COMPRESSOR AND AUTO AIR BYPASS

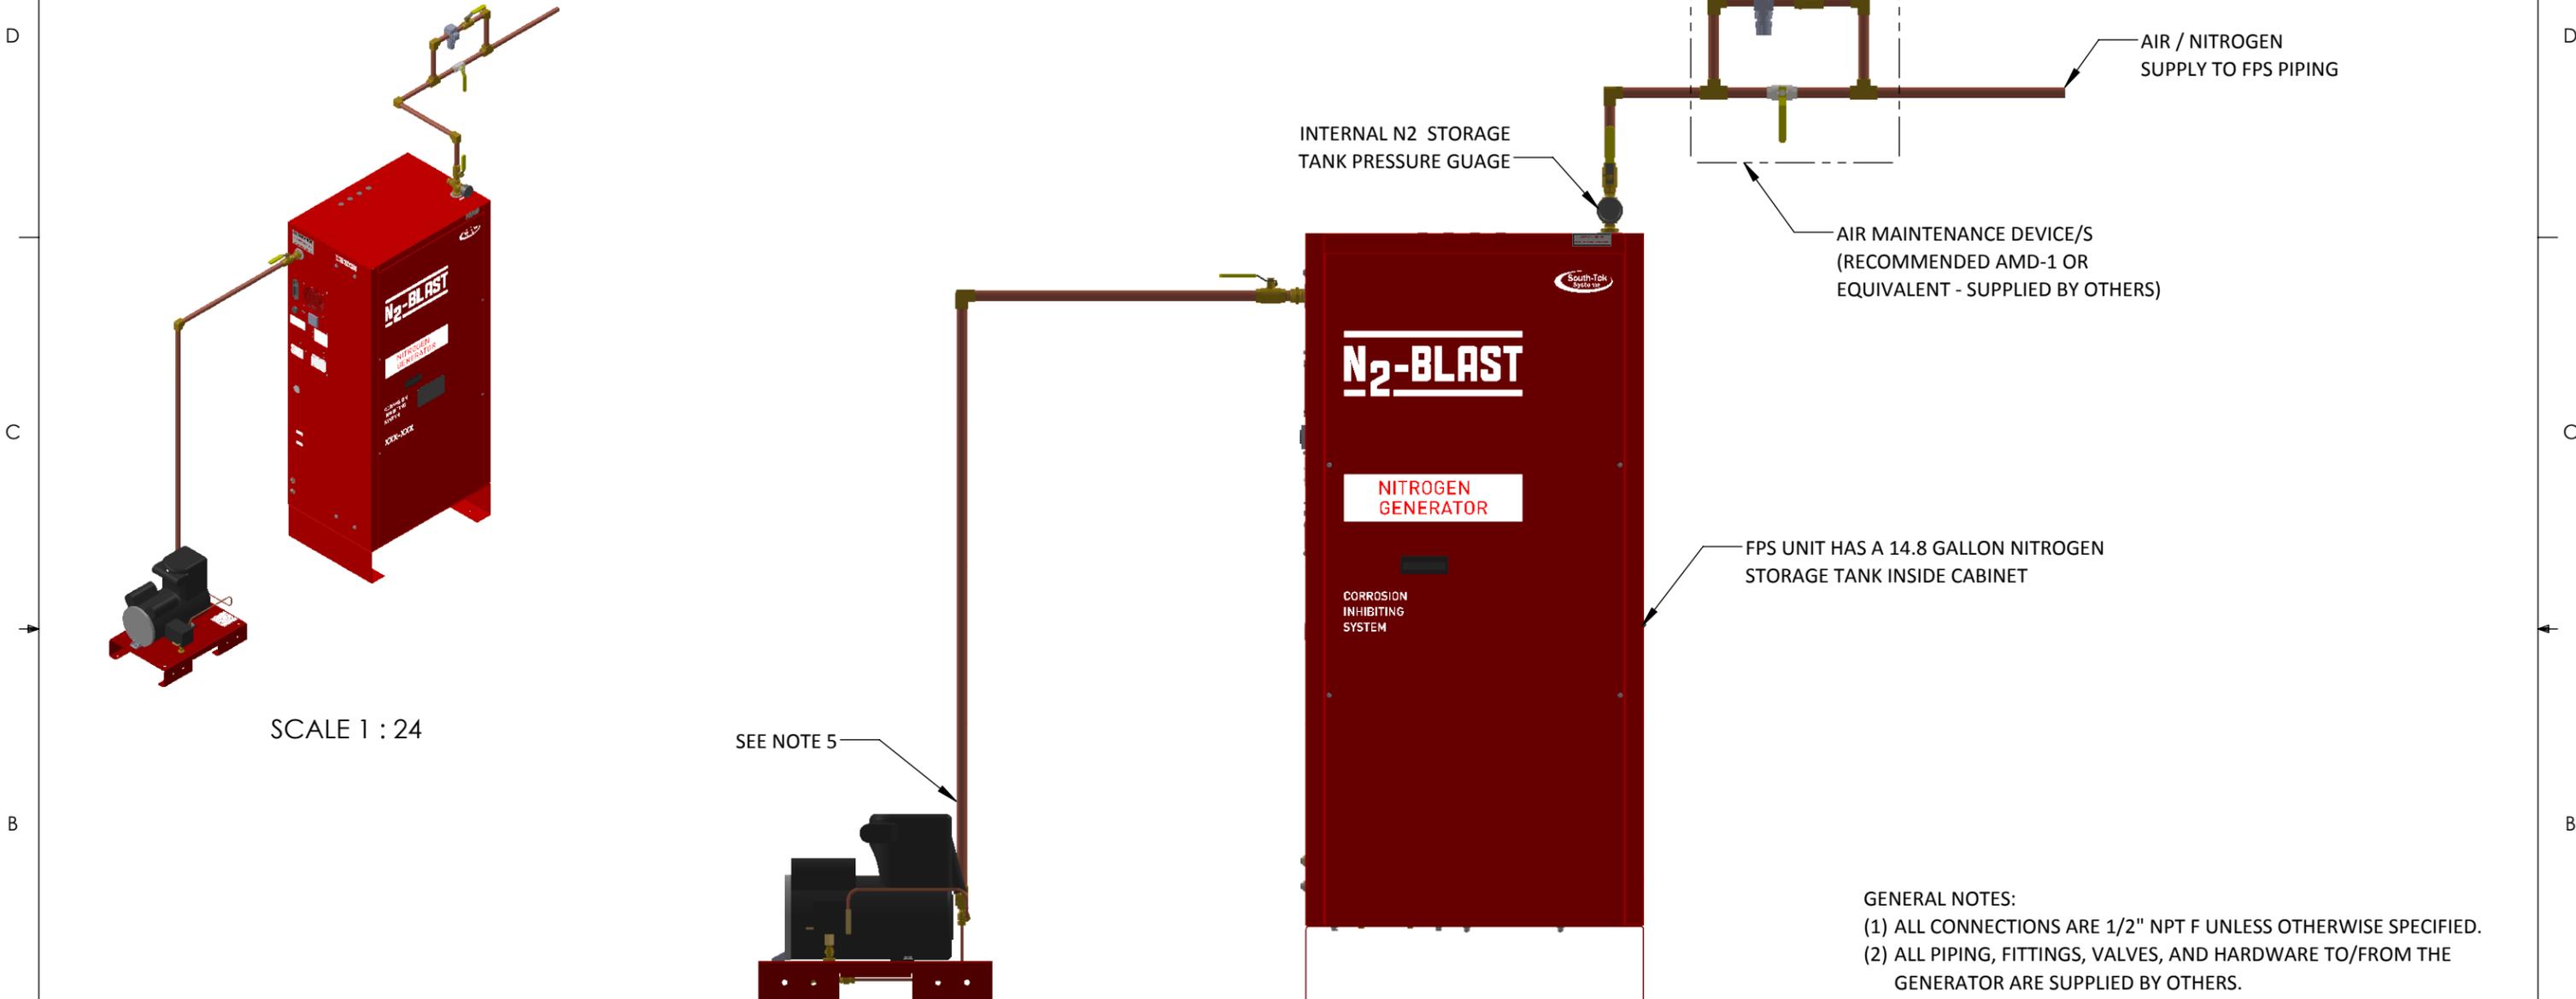


- GENERAL NOTES:
- (1) ALL CONNECTIONS ARE 1/2" NPT F UNLESS OTHERWISE SPECIFIED.
 - (2) ALL PIPING, FITTINGS, VALVES, AND HARDWARE TO/FROM THE GENERATOR ARE SUPPLIED BY OTHERS.
 - (3) ALL EQUIPMENT MUST BE INSTALLED ON A HARD FLAT SURFACE.
 - (4) FOR DESIGN DATA OF NITROGEN GENERATOR SEE DRAWING DD-TYP4P-FPS.
 - (5) SOUTH-TEK RECOMMENDS TO INSTALL 24" OF "1/2" ID FLEX TUBING RATED FOR 200 PSIG / 135 F (MINIMUM) TO REDUCE VIBRATION FROM COMPRESSOR TO HARD PIPING (OPTIONAL PART NUMBER "002-310")

<table border="1"> <tr> <td>01</td> <td>10320</td> <td>-</td> <td>MODIFIED FPS-1650 AUTO BYPASS INPUT LOCATION</td> <td>03/12/18</td> <td>PJS</td> <td>MRT</td> </tr> <tr> <td>00</td> <td>-</td> <td>-</td> <td>RELEASE FOR USE IN SALES DRAWINGS</td> <td>01/12/18</td> <td>PJS</td> <td>MRT</td> </tr> <tr> <th>REV</th> <th>TASK#</th> <th>SHEET</th> <th>DESCRIPTION</th> <th>DATE</th> <th>DRAWN</th> <th>APPR.</th> </tr> </table>							01	10320	-	MODIFIED FPS-1650 AUTO BYPASS INPUT LOCATION	03/12/18	PJS	MRT	00	-	-	RELEASE FOR USE IN SALES DRAWINGS	01/12/18	PJS	MRT	REV	TASK#	SHEET	DESCRIPTION	DATE	DRAWN	APPR.			<p>PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF SOUTH-TEK SYSTEMS. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF SOUTH-TEK SYSTEMS IS PROHIBITED.</p>				<p>MATERIAL:</p>		<p>TYP4P WITH AUTO BYPASS, GENERAL ARRANGEMENT PACKAGE</p>		<p>DRAWN: PJS</p>	<p>APPROVED: MRT</p>
01	10320	-	MODIFIED FPS-1650 AUTO BYPASS INPUT LOCATION	03/12/18	PJS	MRT																																	
00	-	-	RELEASE FOR USE IN SALES DRAWINGS	01/12/18	PJS	MRT																																	
REV	TASK#	SHEET	DESCRIPTION	DATE	DRAWN	APPR.																																	
<p>REVISIONS: ONLY THE LATEST 3 REVISIONS WILL BE SHOWN. OLDER REVISIONS CONSOLIDATED AND FILED.</p>		<p>UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES</p> <table border="1"> <tr> <th>ANGLES</th> <th>X.</th> <th>.X</th> <th>.XX</th> <th>.XXX</th> <th>X/X<10'</th> <th>X/X>10'</th> </tr> <tr> <td>±.5°</td> <td>±1</td> <td>±.2</td> <td>±.03</td> <td>±.005</td> <td>±1/16</td> <td>±1/8</td> </tr> </table>		ANGLES	X.	.X	.XX	.XXX	X/X<10'	X/X>10'	±.5°	±1	±.2	±.03	±.005	±1/16	±1/8	<p>PROJECT NAME: CUSTOMER PACKAGES</p>		<p>DATE: 01/12/18</p>	<p>DATE: 03/13/18</p>																		
ANGLES	X.	.X	.XX	.XXX	X/X<10'	X/X>10'																																	
±.5°	±1	±.2	±.03	±.005	±1/16	±1/8																																	
							<p>WEIGHT:</p>		<p>NUMBER: GA-TYP4P-FPS-A</p>		<p>SCALE: 1:12</p>	<p>SHEET: 1 OF 2</p>																											
											<p>SIZE: B</p>	<p>REVISION: 01</p>																											


FPS-3250 - FPS-5000

FPS-3250/FPS-5000 W/ VERTICAL 5 HP , 7.5 HP OR 10HP AIR COMPRESSOR AND AUTO AIR BYPASS

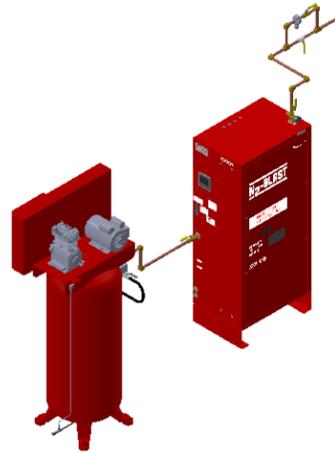


(5HP COMPRESSOR SHOWN) SCALE 1 : 48

FPS-3250/FPS-5000 W/ VERTICAL 2HP COMPRESSOR AND AUTO AIR BYPASS

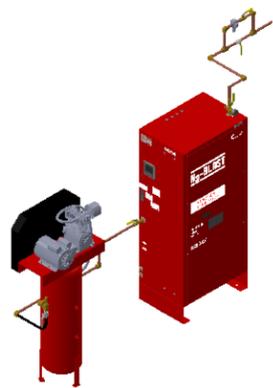


(2HP COMPRESSOR) SCALE 1 : 52

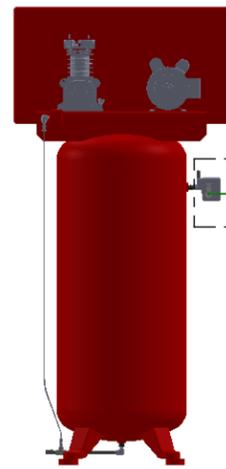

SCALE 1 : 28


SEE NOTE 5

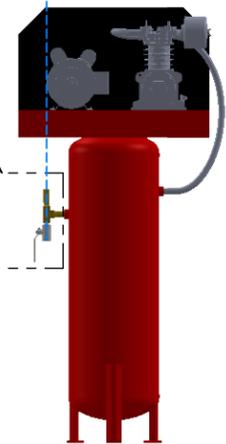

SCALE 1 : 24

SEE NOTE 5

INTERNAL N2 STORAGE TANK PRESSURE GAUGE

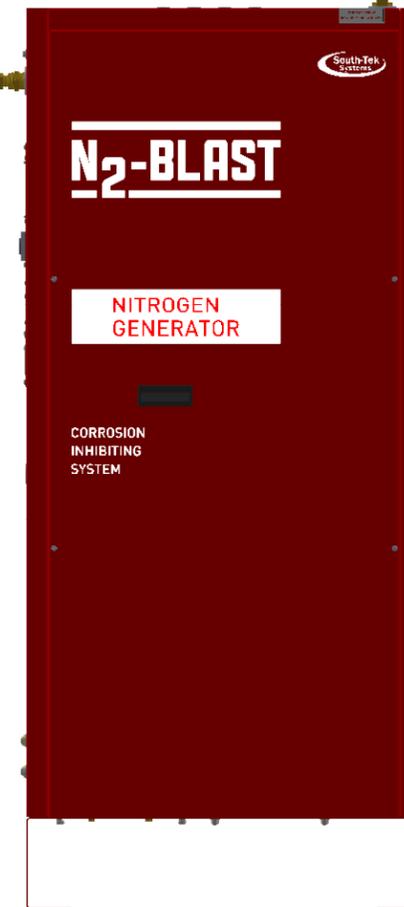

FPS UNIT HAS A 14.8 GALLON NITROGEN STORAGE TANK INSIDE CABINET

GENERAL NOTES:

- (1) ALL CONNECTIONS ARE 1/2" NPT F UNLESS OTHERWISE SPECIFIED.
- (2) ALL PIPING, FITTINGS, VALVES, AND HARDWARE TO/FROM THE GENERATOR ARE SUPPLIED BY OTHERS.
- (3) ALL EQUIPMENT MUST BE INSTALLED ON A HARD FLAT SURFACE.
- (4) FOR DESIGN DATA OF NITROGEN GENERATOR SEE DRAWING DD-TYP4P-FPS.
- (5) SOUTH-TEK RECOMMENDS TO INSTALL 24" OF "1/2" ID FLEX TUBING RATED FOR 200 PSIG / 135 F (MINIMUM) TO REDUCE VIBRATION FROM COMPRESSOR TO HARD PIPING (OPTIONAL PART NUMBER "002-310")

AIR / NITROGEN SUPPLY TO FPS PIPING

AIR MAINTENANCE DEVICE/S (RECOMMENDED AMD-1 OR EQUIVALENT - SUPPLIED BY OTHERS)

REV	TASK#	SHEET	DESCRIPTION	DATE	DRAWN	APPR.
-	-	-	-	-	-	-
01	10320	-	MODIFIED FPS-1650 AUTO BYPASS INPUT LOCATION	03/12/18	PJS	MRT
00	-	-	RELEASE FOR USE IN SALES DRAWINGS	01/12/18	PJS	MRT

REVISIONS: ONLY THE LATEST 3 REVISIONS WILL BE SHOWN. OLDER REVISIONS CONSOLIDATED AND FILED.




PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF SOUTH-TEK SYSTEMS. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF SOUTH-TEK SYSTEMS IS PROHIBITED.

MATERIAL:		TYP4P WITH AUTO BYPASS, GENERAL ARRANGEMENT PACKAGE	
FINISH:		CUSTOMER PACKAGES	
WEIGHT:		PROJECT NAME:	
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES		NUMBER:	
ANGLES	X.	.X	.XX
±.5°	±1	±.2	±.03
			±.005
			±1/16
			±1/8

DRAWN: PJS		APPROVED: MRT	
DATE: 01/12/18		DATE: 03/13/18	
SIZE: B	SCALE: 1:12	SHEET: 2 OF 2	
GA-TYP4P-FPS-A		REVISION: 01	

FPS-1650-P-A

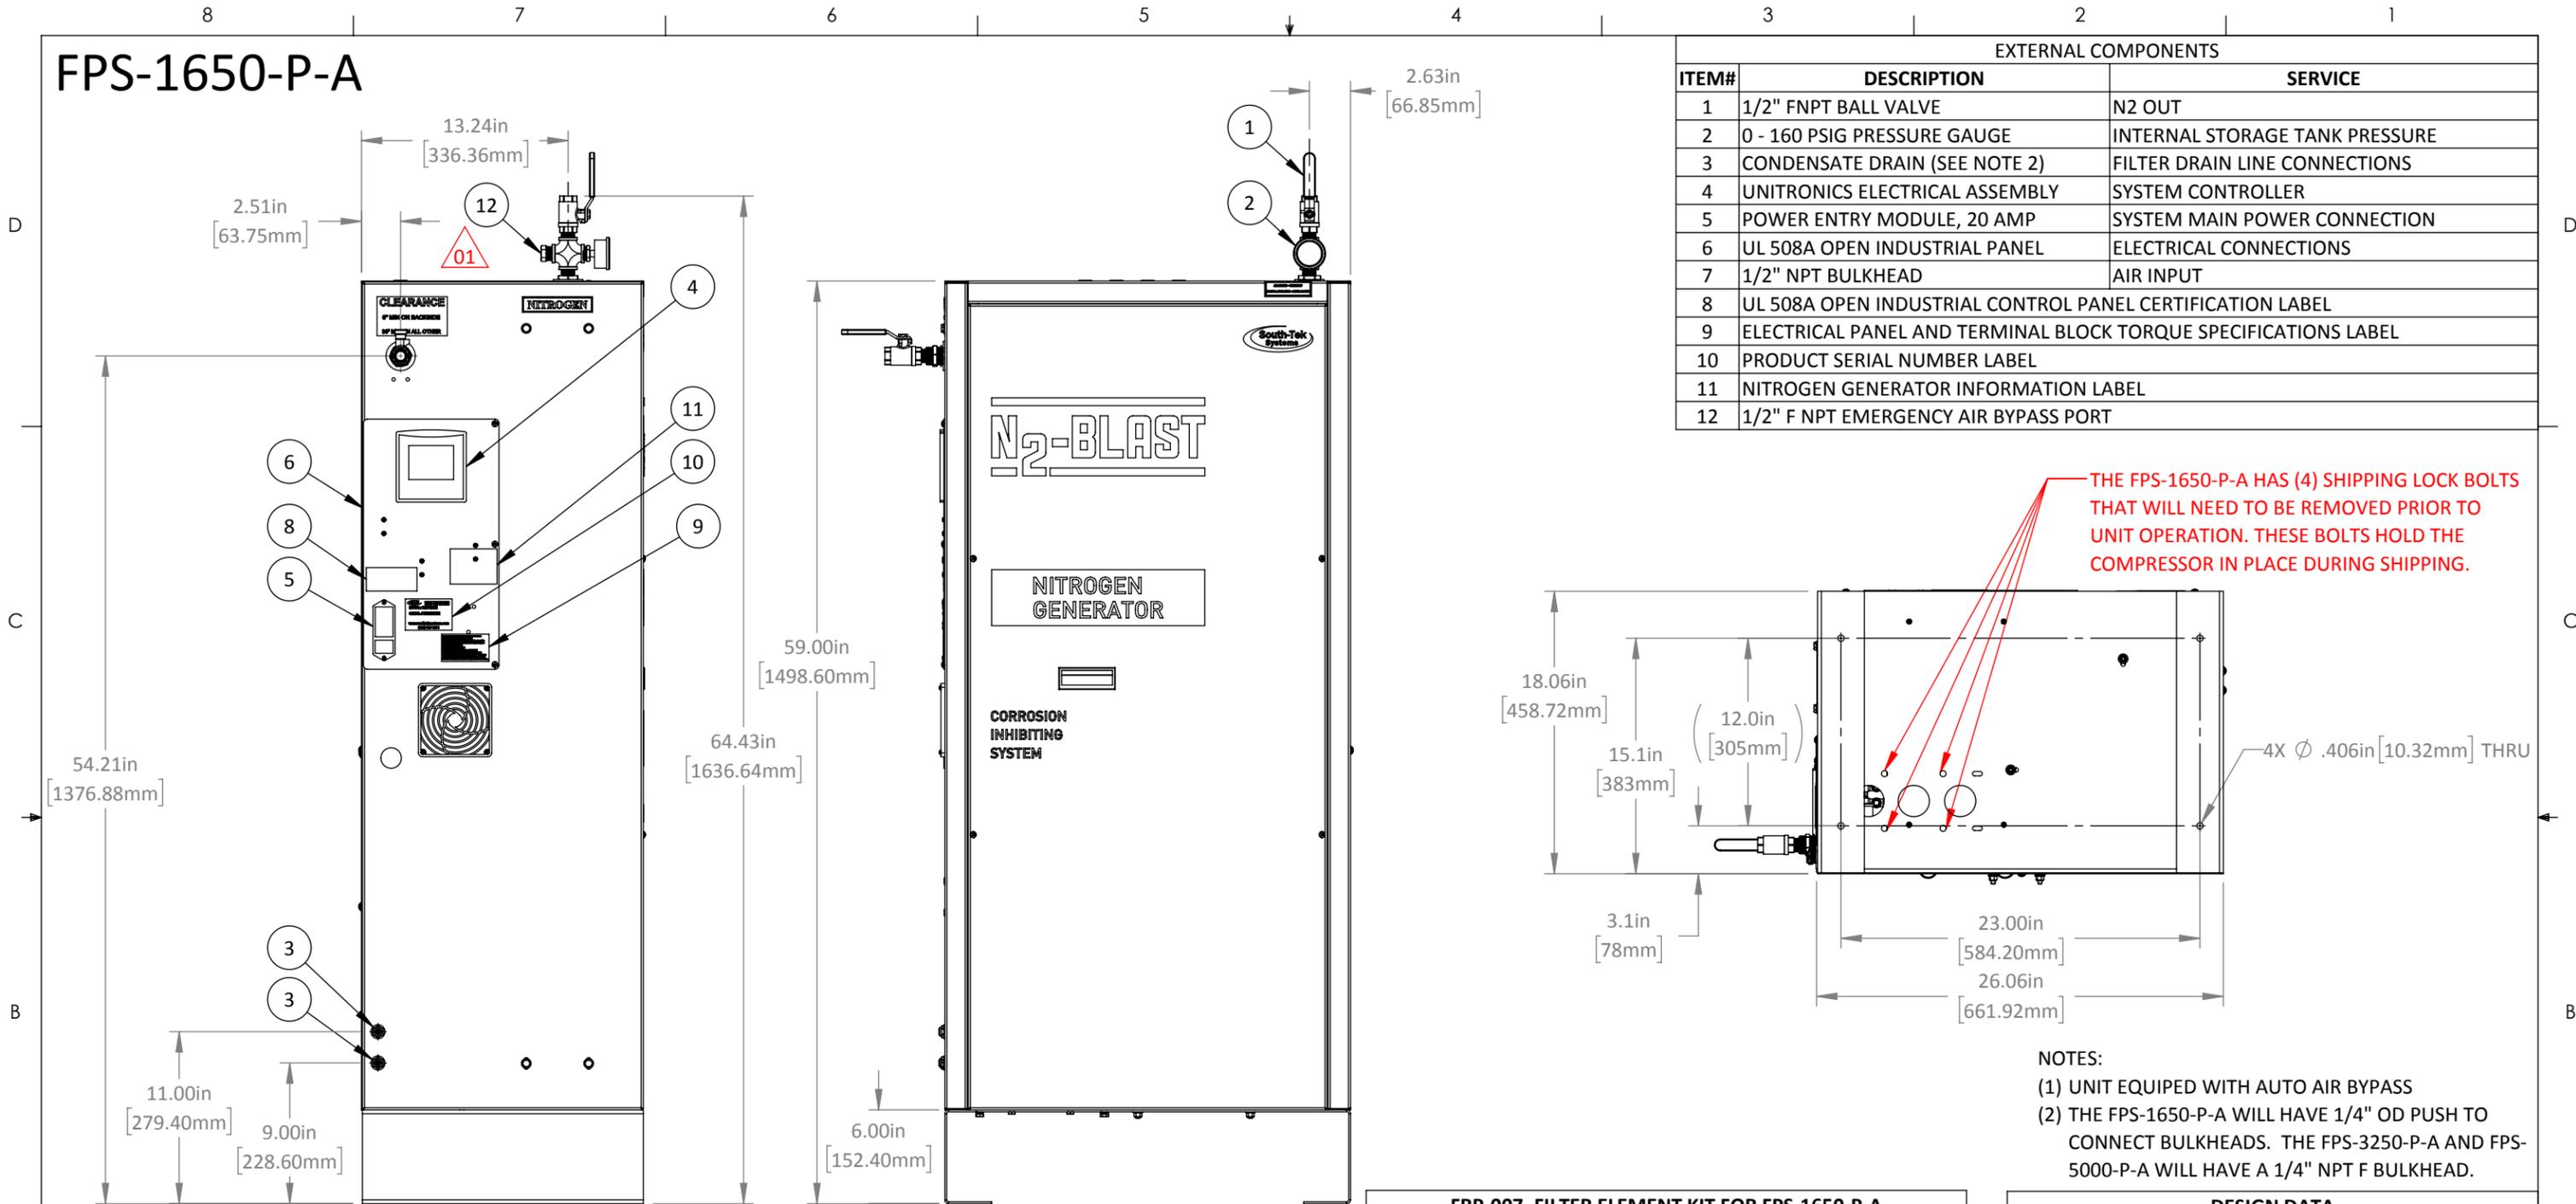

EXTERNAL COMPONENTS		
ITEM#	DESCRIPTION	SERVICE
1	1/2" FNPT BALL VALVE	N2 OUT
2	0 - 160 PSIG PRESSURE GAUGE	INTERNAL STORAGE TANK PRESSURE
3	CONDENSATE DRAIN (SEE NOTE 2)	FILTER DRAIN LINE CONNECTIONS
4	UNITRONICS ELECTRICAL ASSEMBLY	SYSTEM CONTROLLER
5	POWER ENTRY MODULE, 20 AMP	SYSTEM MAIN POWER CONNECTION
6	UL 508A OPEN INDUSTRIAL PANEL	ELECTRICAL CONNECTIONS
7	1/2" NPT BULKHEAD	AIR INPUT
8	UL 508A OPEN INDUSTRIAL CONTROL PANEL CERTIFICATION LABEL	
9	ELECTRICAL PANEL AND TERMINAL BLOCK TORQUE SPECIFICATIONS LABEL	
10	PRODUCT SERIAL NUMBER LABEL	
11	NITROGEN GENERATOR INFORMATION LABEL	
12	1/2" F NPT EMERGENCY AIR BYPASS PORT	

THE FPS-1650-P-A HAS (4) SHIPPING LOCK BOLTS THAT WILL NEED TO BE REMOVED PRIOR TO UNIT OPERATION. THESE BOLTS HOLD THE COMPRESSOR IN PLACE DURING SHIPPING.

NOTES:
 (1) UNIT EQUIPED WITH AUTO AIR BYPASS
 (2) THE FPS-1650-P-A WILL HAVE 1/4" OD PUSH TO CONNECT BULKHEADS. THE FPS-3250-P-A AND FPS-5000-P-A WILL HAVE A 1/4" NPT F BULKHEAD.

FRP-007, FILTER ELEMENT KIT FOR FPS-1650-P-A		
STS PART #	DESCRIPTION	QTY.
900-135	REPLACEMENT PRE-COMPRESSOR AIR FILTER	1
900-137-MB	PARTICULATE FILTER ELEMENT	1
900-140-MB	COALESCING FILTER ELEMENT	1
120-020-E	O-RING FOR FILTER BOWLS	2

	DESIGN DATA		
	FPS-1650	FPS-3250	FPS-5000
PURITY	98% +		
N2 OUT PRESSURE	UP TO 80 PSI		
SHIPPING WEIGHT	223 LBS	243 LBS	303 LBS
ELECTRICAL	110-240V / 60-50HZ / 1PHASE, 7.1AMPS		

REV	TASK#	SHEET	DESCRIPTION	DATE	DRAWN	APPR.
-	-	-	-	-	-	-
01	10320	-	UPDATED FRP KIT PART NUMBER AND ADDED EMERGENCY PORT BALLOON	03/12/18	PJS	MRT
00	-	-	RELEASE FOR USE IN SALES PACKAGES	01/09/18	PJS	MRT

South-Tek Systems

PROPRIETARY AND CONFIDENTIAL
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF SOUTH-TEK SYSTEMS. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF SOUTH-TEK SYSTEMS IS PROHIBITED.

MATERIAL: _____
 FINISH: _____
 WEIGHT: _____ PROJECT NAME: _____
 TYP4P WITH AUTO BYPASS DETAIL DRAWING
 DETAIL DRAWINGS
 NUMBER: DD-TYP4P-P-A
 REVISION: 01

APPROVED: MRT
 DATE: 03/13/18

DATE: 01/09/18

SCALE: 1:10
 SHEET: 1 OF 2

REVISIONS: ONLY THE LATEST 3 REVISIONS WILL BE SHOWN. OLDER REVISIONS CONSOLIDATED AND FILED.



FPS-3250-P-A, FPS-5000-P-A

D

C

B


A

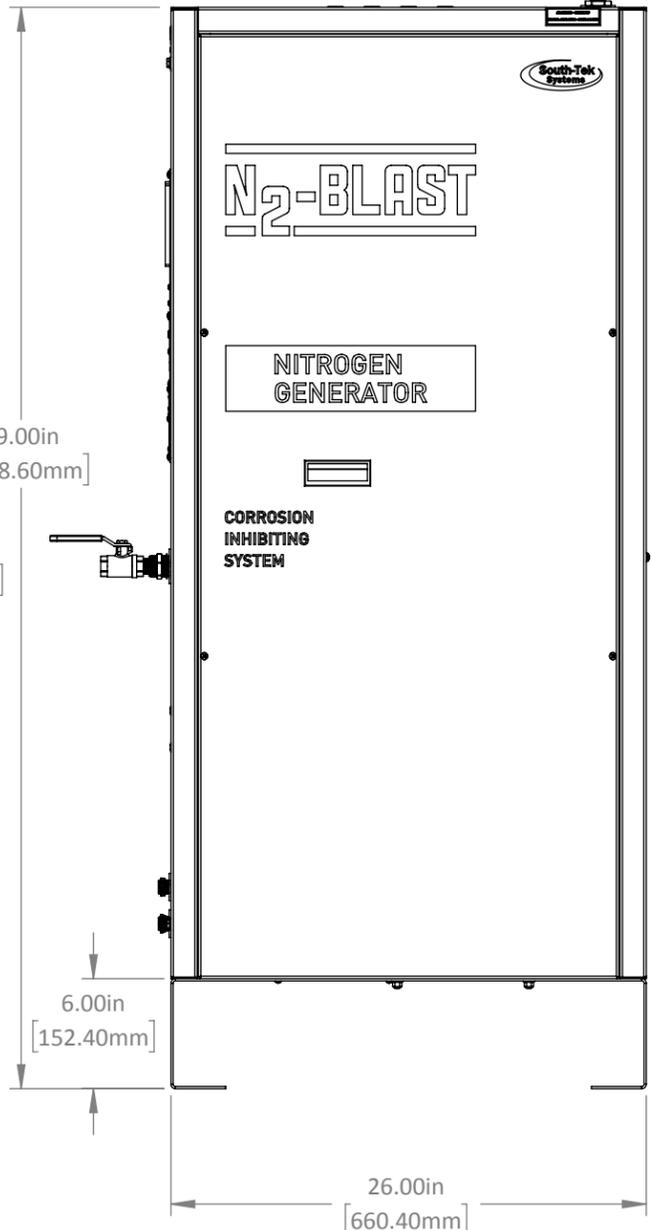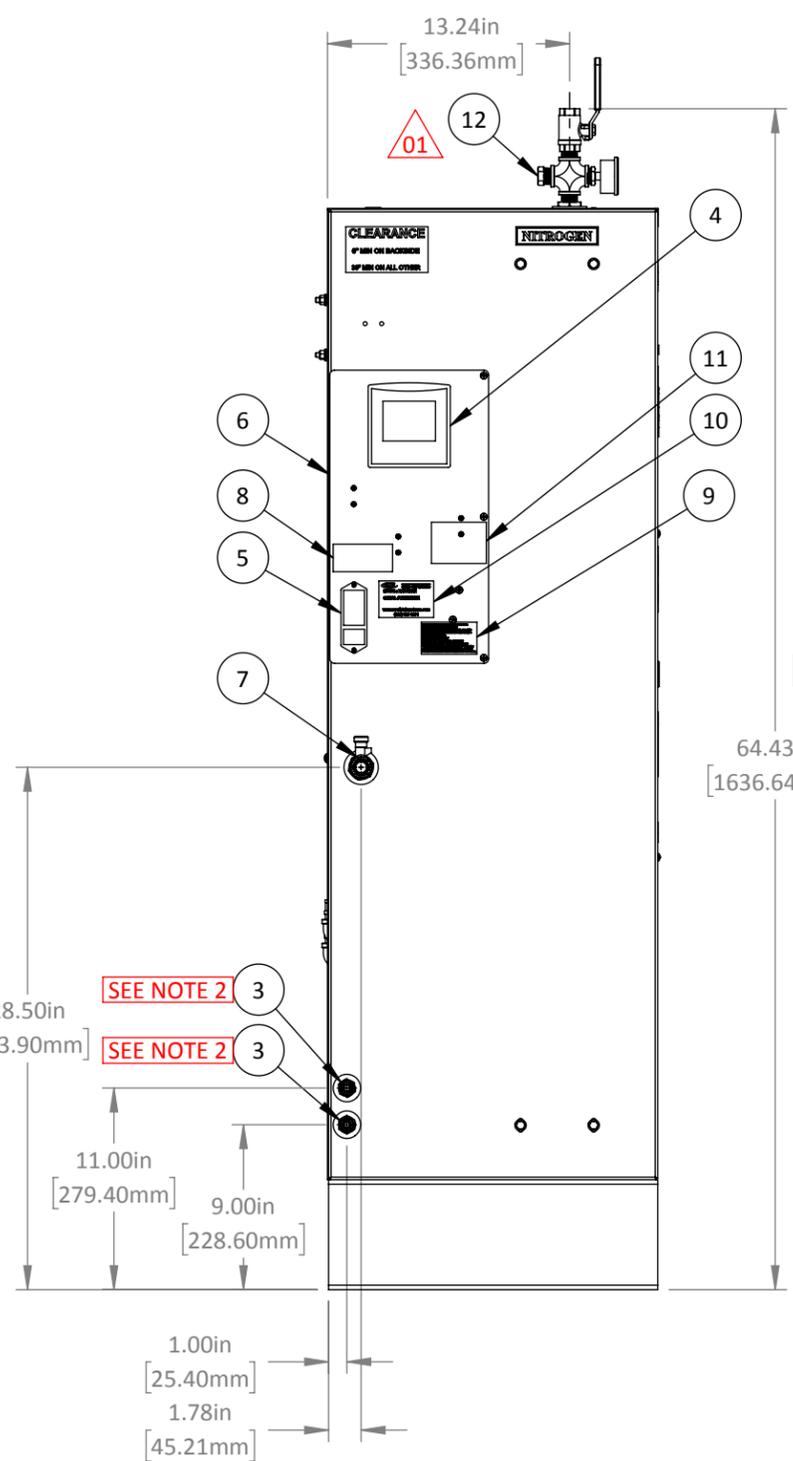

2.63in
[66.85mm]

EXTERNAL COMPONENTS		
ITEM#	DESCRIPTION	SERVICE
1	1/2" FNPT BALL VALVE	N2 OUT
2	0 - 160 PSIG PRESSURE GAUGE	INTERNAL STORAGE TANK PRESSURE
3	CONDENSATE DRAIN (SEE NOTE 2)	FILTER DRAIN LINE CONNECTIONS
4	UNITRONICS ELECTRICAL ASSEMBLY	SYSTEM CONTROLLER
5	POWER ENTRY MODULE, 20 AMP	SYSTEM MAIN POWER CONNECTION
6	UL 508A OPEN INDUSTRIAL PANEL	ELECTRICAL CONNECTIONS
7	1/2" NPT BULKHEAD	AIR INPUT
8	UL 508A OPEN INDUSTRIAL CONTROL PANEL CERTIFICATION LABEL	
9	ELECTRICAL PANEL AND TERMINAL BLOCK TORQUE SPECIFICATIONS LABEL	
10	PRODUCT SERIAL NUMBER LABEL	
11	NITROGEN GENERATOR INFORMATION LABEL	
12	1/2" F NPT EMERGENCY AIR BYPASS PORT	

THE FPS-1650-P-A HAS (4) SHIPPING LOCK BOLTS THAT WILL NEED TO BE REMOVED PRIOR TO UNIT OPERATION. THESE BOLTS HOLD THE COMPRESSOR IN PLACE DURING SHIPPING.

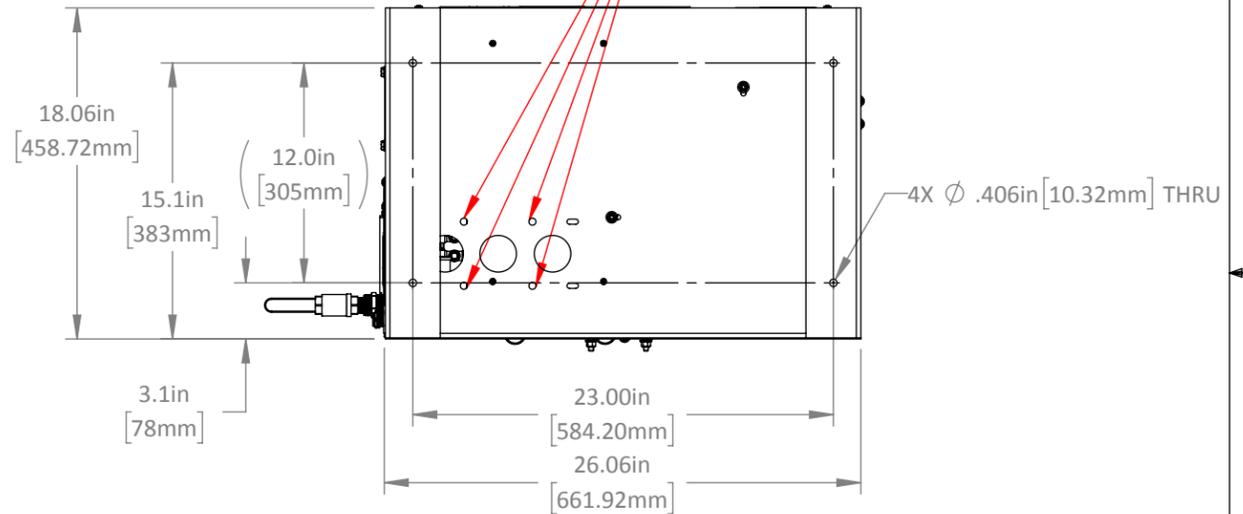

NOTES:
 (1) UNIT EQUIPED WITH AUTO AIR BYPASS
 (2) THE FPS-1650-P-A WILL HAVE 1/4" OD PUSH TO CONNECT BULKHEADS. THE FPS-3250-P-A AND FPS-5000-P-A WILL HAVE A 1/4" NPT F BULKHEAD.

FRP-013, FILTER ELEMENT KIT FOR FPS-3250/5000-P-A		
STS PART #	DESCRIPTION	QTY.
900-300	PARTICULATE FILTER ELEMENT	1
900-310	COALESCING FILTER ELEMENT (MTP-95-548)	1
900-335	ABSORBING FILTER ELEMENT (MXP-95-987)	1

	DESIGN DATA	
	FPS-3250	FPS-5000
PURITY	98% +	
N2 OUT PRESSURE	UP TO 80 PSI	
SHIPPING WEIGHT	243 LBS	303 LBS
ELECTRICAL	110-240V / 60-50HZ / 1PHASE, 7.1AMPS	

REV	TASK#	SHEET	DESCRIPTION	DATE	DRAWN	APPR.
-	-	-	-	-	-	-
01	10320	-	UPDATED FRP KIT PART NUMBER AND ADDED EMERGENCY PORT BALLOON	03/12/18	PJS	MRT
00	-	-	RELEASE FOR USE IN SALES PACKAGES	01/09/18	PJS	MRT




PROPRIETARY AND CONFIDENTIAL
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF SOUTH-TEK SYSTEMS. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF SOUTH-TEK SYSTEMS IS PROHIBITED.

MATERIAL:	TYP4P WITH AUTO BYPASS DETAIL			DRAWN:	APPROVED:
FINISH:	DRAWING			DATE:	DATE:
WEIGHT:	PROJECT NAME:	DETAIL DRAWINGS	SCALE:	SHEET:	
ANGLES	NUMBER:			1:10	2 OF 2
±.5°	DD-TYP4P-P-A			REVISION:	01

REVISIONS: ONLY THE LATEST 3 REVISIONS WILL BE SHOWN. OLDER REVISIONS CONSOLIDATED AND FILED.

8 7 6 5 4 3 2 1

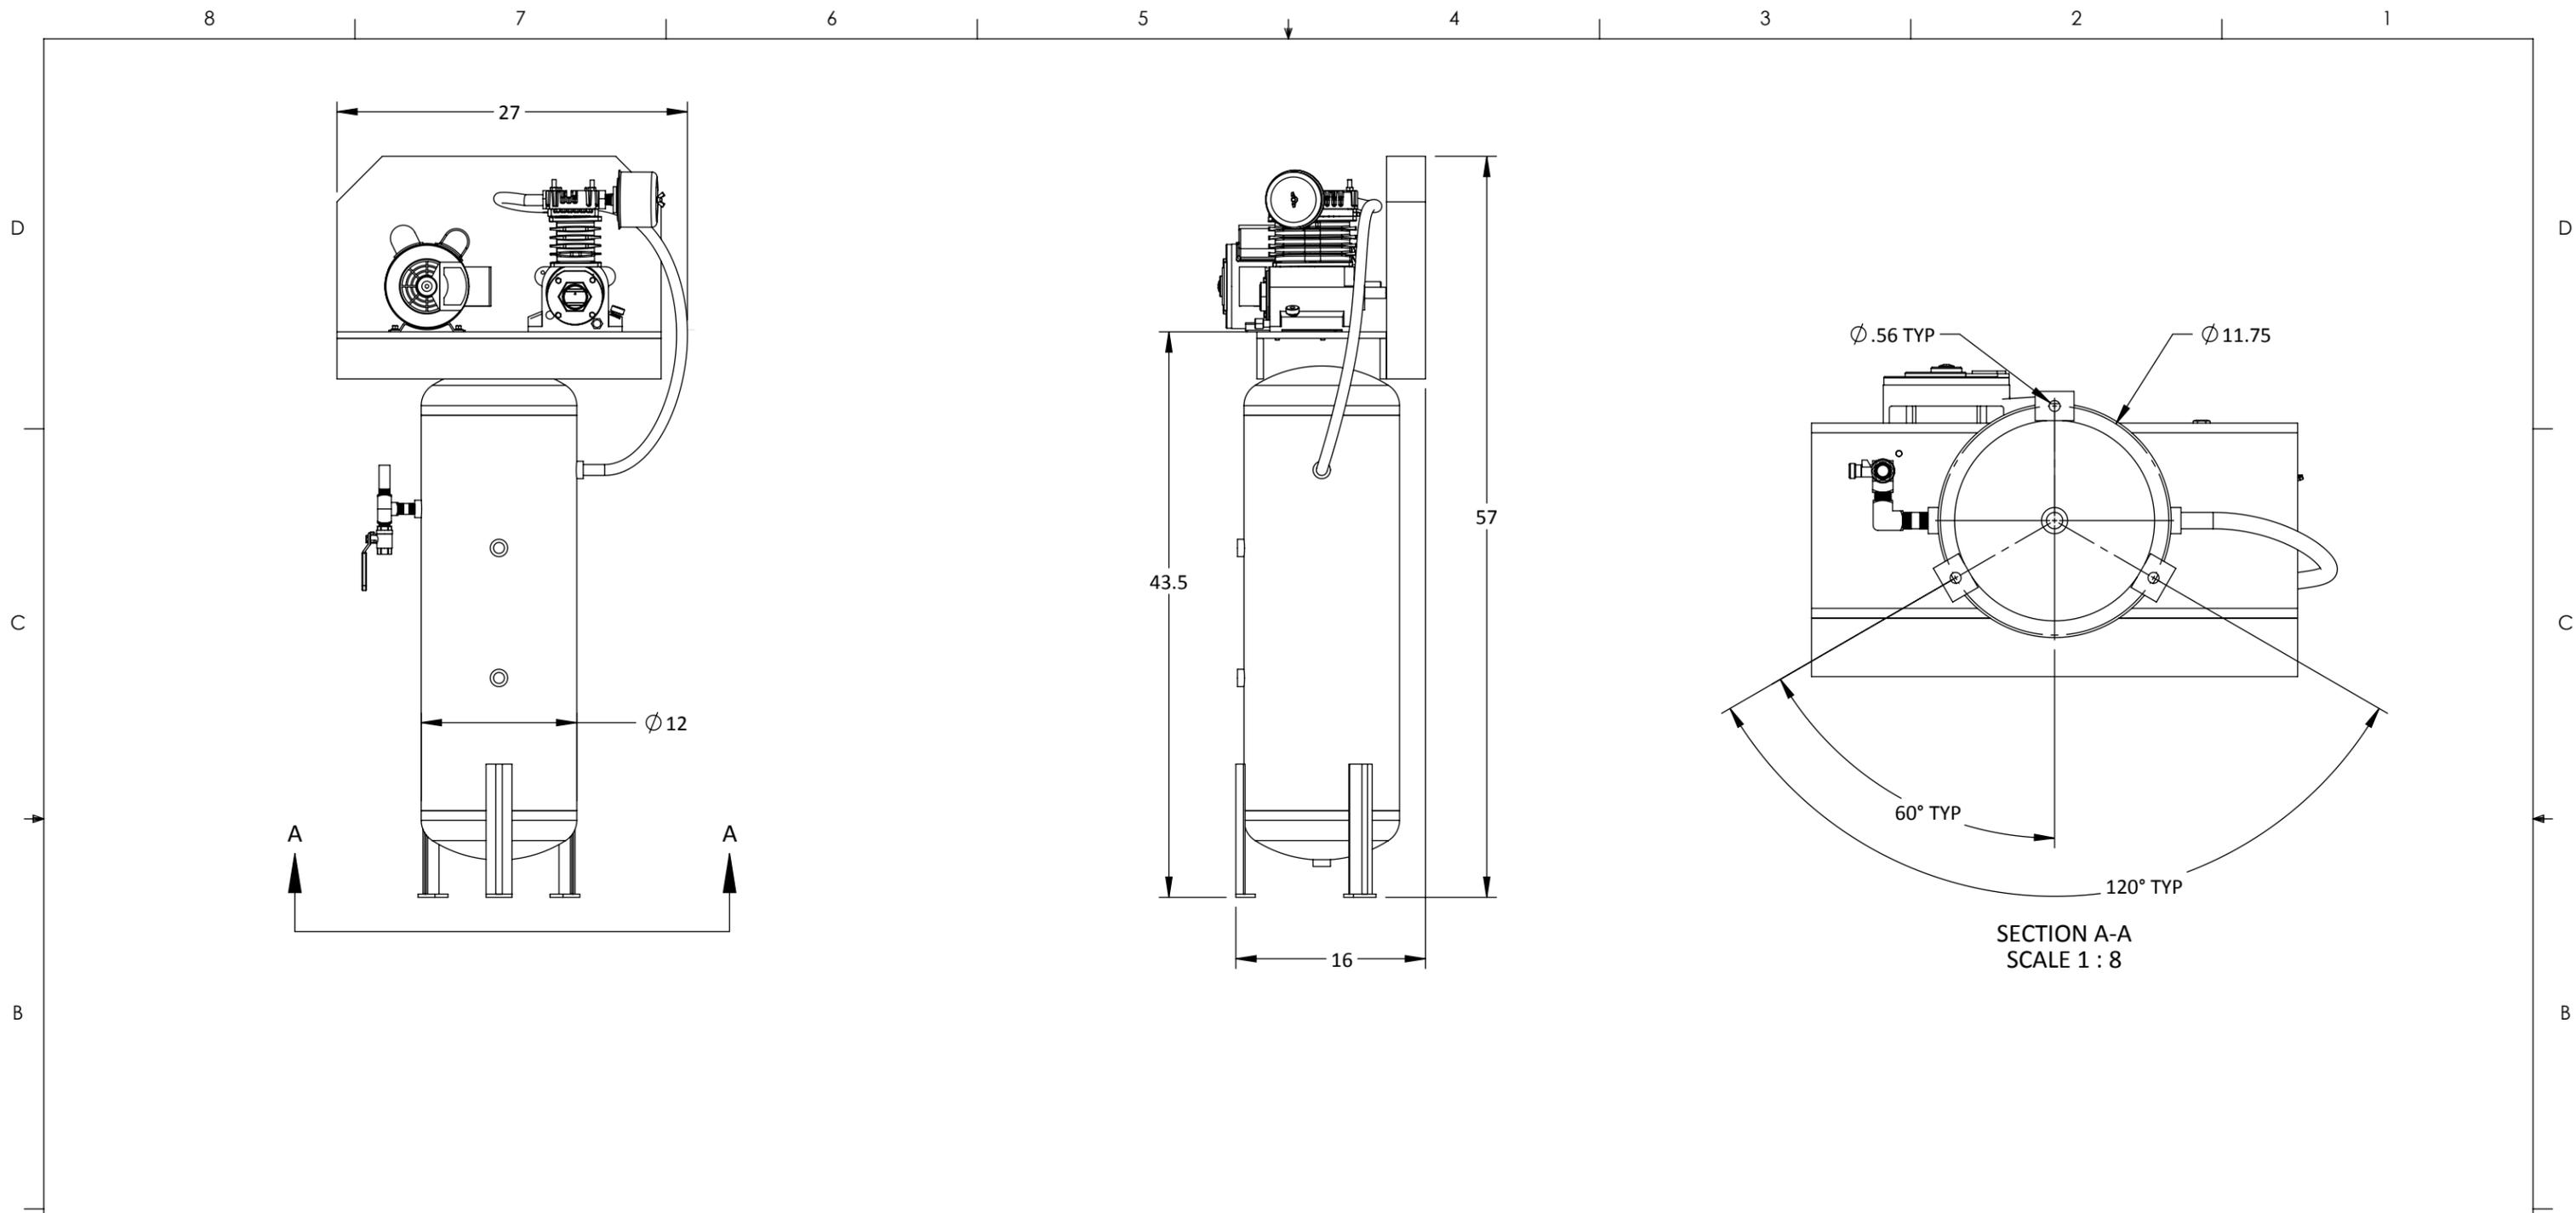

AVAILABLE ELECTRICAL OPTIONS AND DESIGN DATA

STS PART #	CUSTOMER #	ELECTRICAL	MOTOR	AIR FLOW	WEIGHT
2223-0006	STS-NF-C-2-J	120V / 60Hz / 1PHASE, 18.4 AMPS 230V / 60Hz / 1PHASE, 9.2 AMPS	2 HP	7.6 SCFM @ 120 - 140 PSI	250 LBS

REV	TASK#	SHEET	DESCRIPTION	DATE	DRAWN	APPR.
-	-	-	-	-	-	-
00	-	-	RELEASED	1/11/2018	JVN	JVN



PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF SOUTH-TEK SYSTEMS. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF SOUTH-TEK SYSTEMS IS PROHIBITED.

MATERIAL:
FINISH:
WEIGHT:

(2-J) AIR COMPRESSOR DESIGN DATA AND DIMENSIONS

DRAWN: JVN
DATE: 01/11/18
APPROVED: JVN
DATE: 01/11/18
SIZE: B
SCALE: 1:16
SHEET: 1 OF 1

REVISIONS: ONLY THE LATEST 3 REVISIONS WILL BE SHOWN. OLDER REVISIONS CONSOLIDATED AND FILED.


ANGLES	X.	.X	.XX	.XXX	X/X<10'	X/X>10'
$\pm .5^\circ$	± 1	$\pm .2$	$\pm .03$	$\pm .005$	$\pm 1/16$	$\pm 1/8$

NUMBER: DD-AC-2-J
REVISION: 00




8 7 6 5 4 3 2 1

8 7 6 5 4 3 2 1

STS-NF-C-5-CS

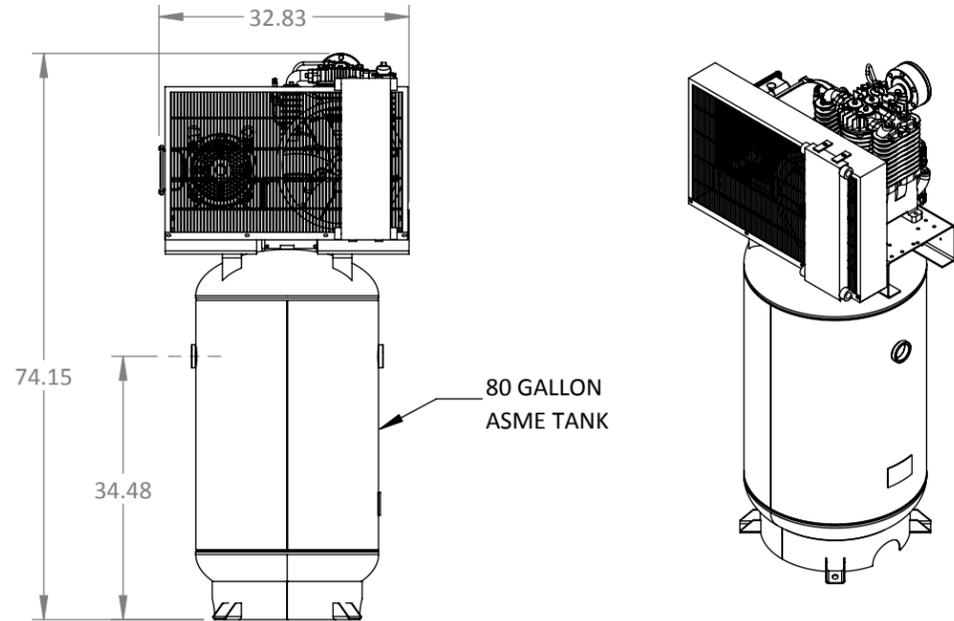

STS-NF-C-7-CS AND STS-NF-C-7HD-CS

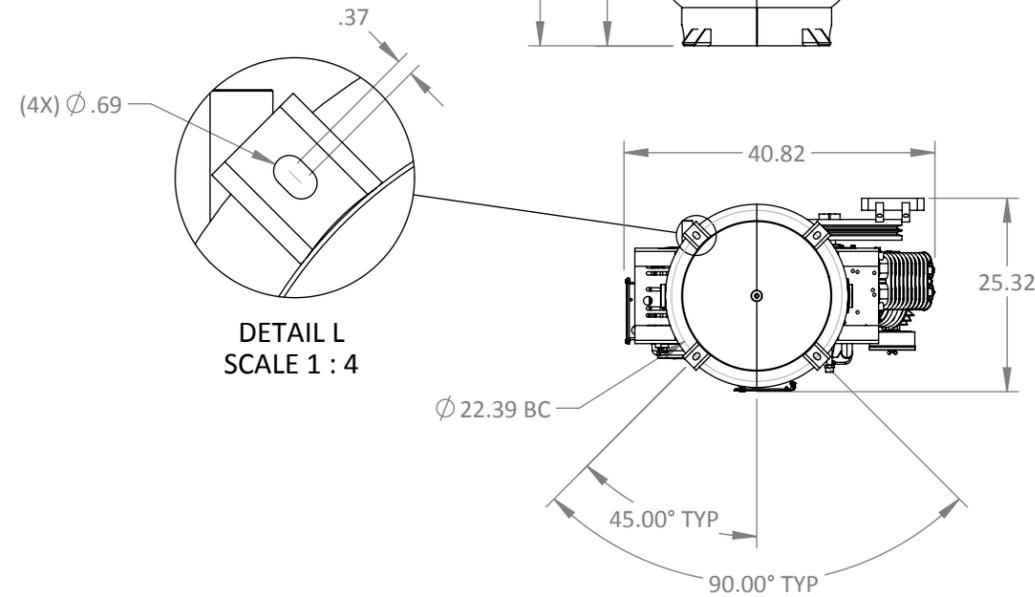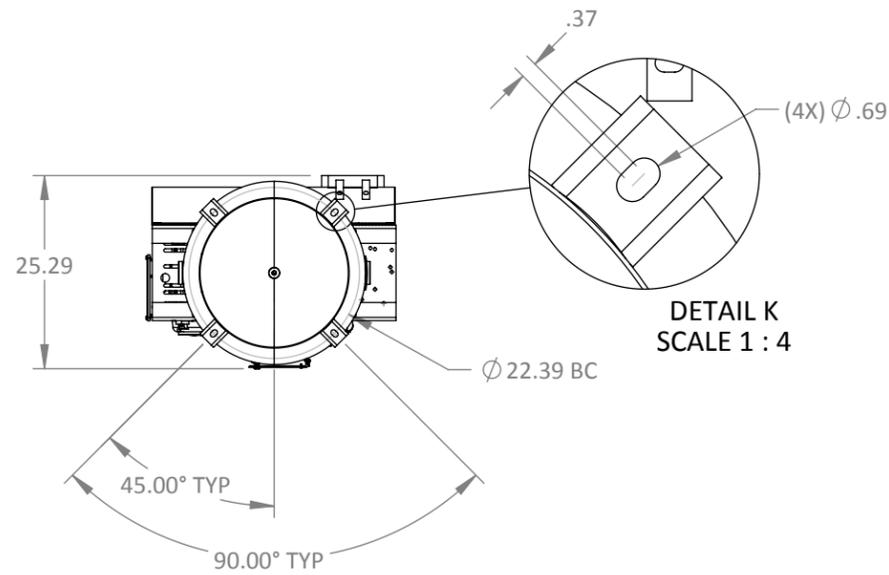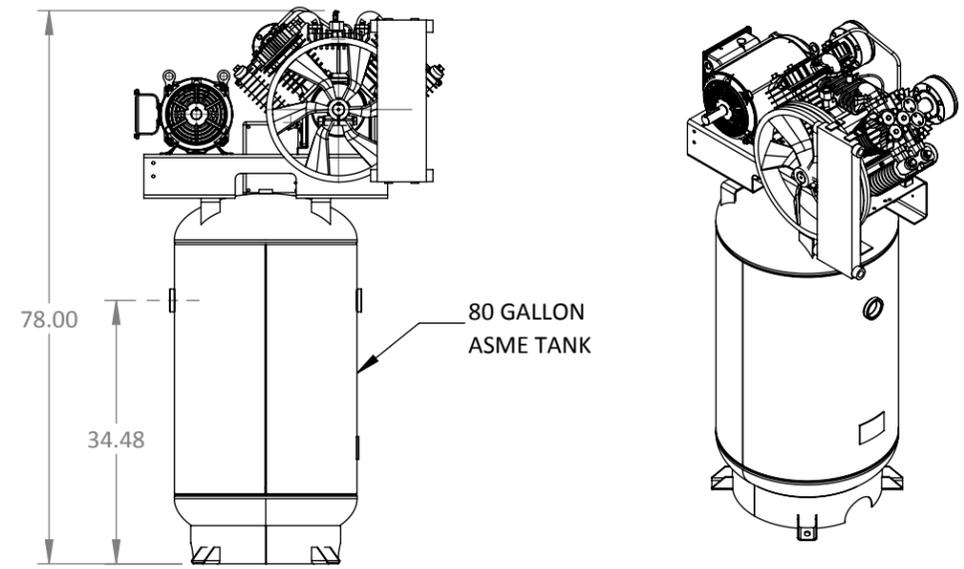

**80 GALLON VERTICAL ASME TANK
ELITE W/ COOLER (MAG STARTER, AUTO TANK
DRAIN, LOW OIL MONITOR, VIBRATION PADS)
1/4" NPT AUTO-DRAIN CONNECTION PORT
LOCATED NEAR BOTTOM OF THE TANK. PIPE
TO SITE DRAIN.**

STS PART # (XXX) = VOLTAGE	CUSTOMER #	MOTOR (HP)	AIR FLOW (SCFM @175)	DIMENSIONS (L" X W" X H")	WEIGHT (LBS)	ELECTRICAL OPTIONS / AMPS	1 YEAR SERVICE KIT #	2 YEAR SERVICE KIT #
CS-050-(XXX)-16	STS-NF-C-5-CS	5	17.5	33 X 26 X 74	685	208-230V/1PH/24A	CS-050-075-KIT1	CS-050-KIT2
CS-050-(XXX)-36						230-460V/3PH/(16A-8A)		
CS-075-(XXX)-36	STS-NC-C-7-CS	7.5	24	41 X 26 X 78	885 lbs	230-460V/3PH/(18A-9A)	CS-075HD-100-KIT1	CS-075-KIT2
CS-075HD-(XXX)-36	STS-NF-C-7HD-CS		28			230-460V/3PH/(18A-9A)		CS-075HD-KIT2
CS-100-(XXX)-36	STS-NF-C-10-CS		35			230-460V/3PH/(28A-14A)		CS-100-KIT3

REV	TASK#	SHEET	DESCRIPTION	DATE	DRAWN	APPR.
-	-	-	-	-	-	-
0	-	-	RELEASED	1/11/18	JVN	JVN




PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF SOUTH-TEK SYSTEMS. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF SOUTH-TEK SYSTEMS IS PROHIBITED.

MATERIAL:		(CS) VERTICAL COMPRESSOR DESIGN DATA AND DIMENSIONS		DRAWN: JVN	APPROVED: JVN														
FINISH:				DATE: 01/12/18	DATE: 01/12/18														
WEIGHT:		PROJECT NAME:		SIZE: B	SCALE: 1:24														
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES		NUMBER: DD-AC-CS		SHEET: 1 OF 1															
<table border="1" style="font-size: small;"> <tr> <th>ANGLES</th> <th>X.</th> <th>.X</th> <th>.XX</th> <th>.XXX</th> <th>X/X<10'</th> <th>X/X>10'</th> </tr> <tr> <td>±.5°</td> <td>±1</td> <td>±.2</td> <td>±.03</td> <td>±.005</td> <td>±1/16</td> <td>±1/8</td> </tr> </table>		ANGLES	X.	.X	.XX	.XXX	X/X<10'	X/X>10'	±.5°	±1	±.2	±.03	±.005	±1/16	±1/8			REVISION: 00	
ANGLES	X.	.X	.XX	.XXX	X/X<10'	X/X>10'													
±.5°	±1	±.2	±.03	±.005	±1/16	±1/8													

REVISIONS: ONLY THE LATEST 3 REVISIONS WILL BE SHOWN. OLDER REVISIONS CONSOLIDATED AND FILED.

RELEASED TO PRODUCTION

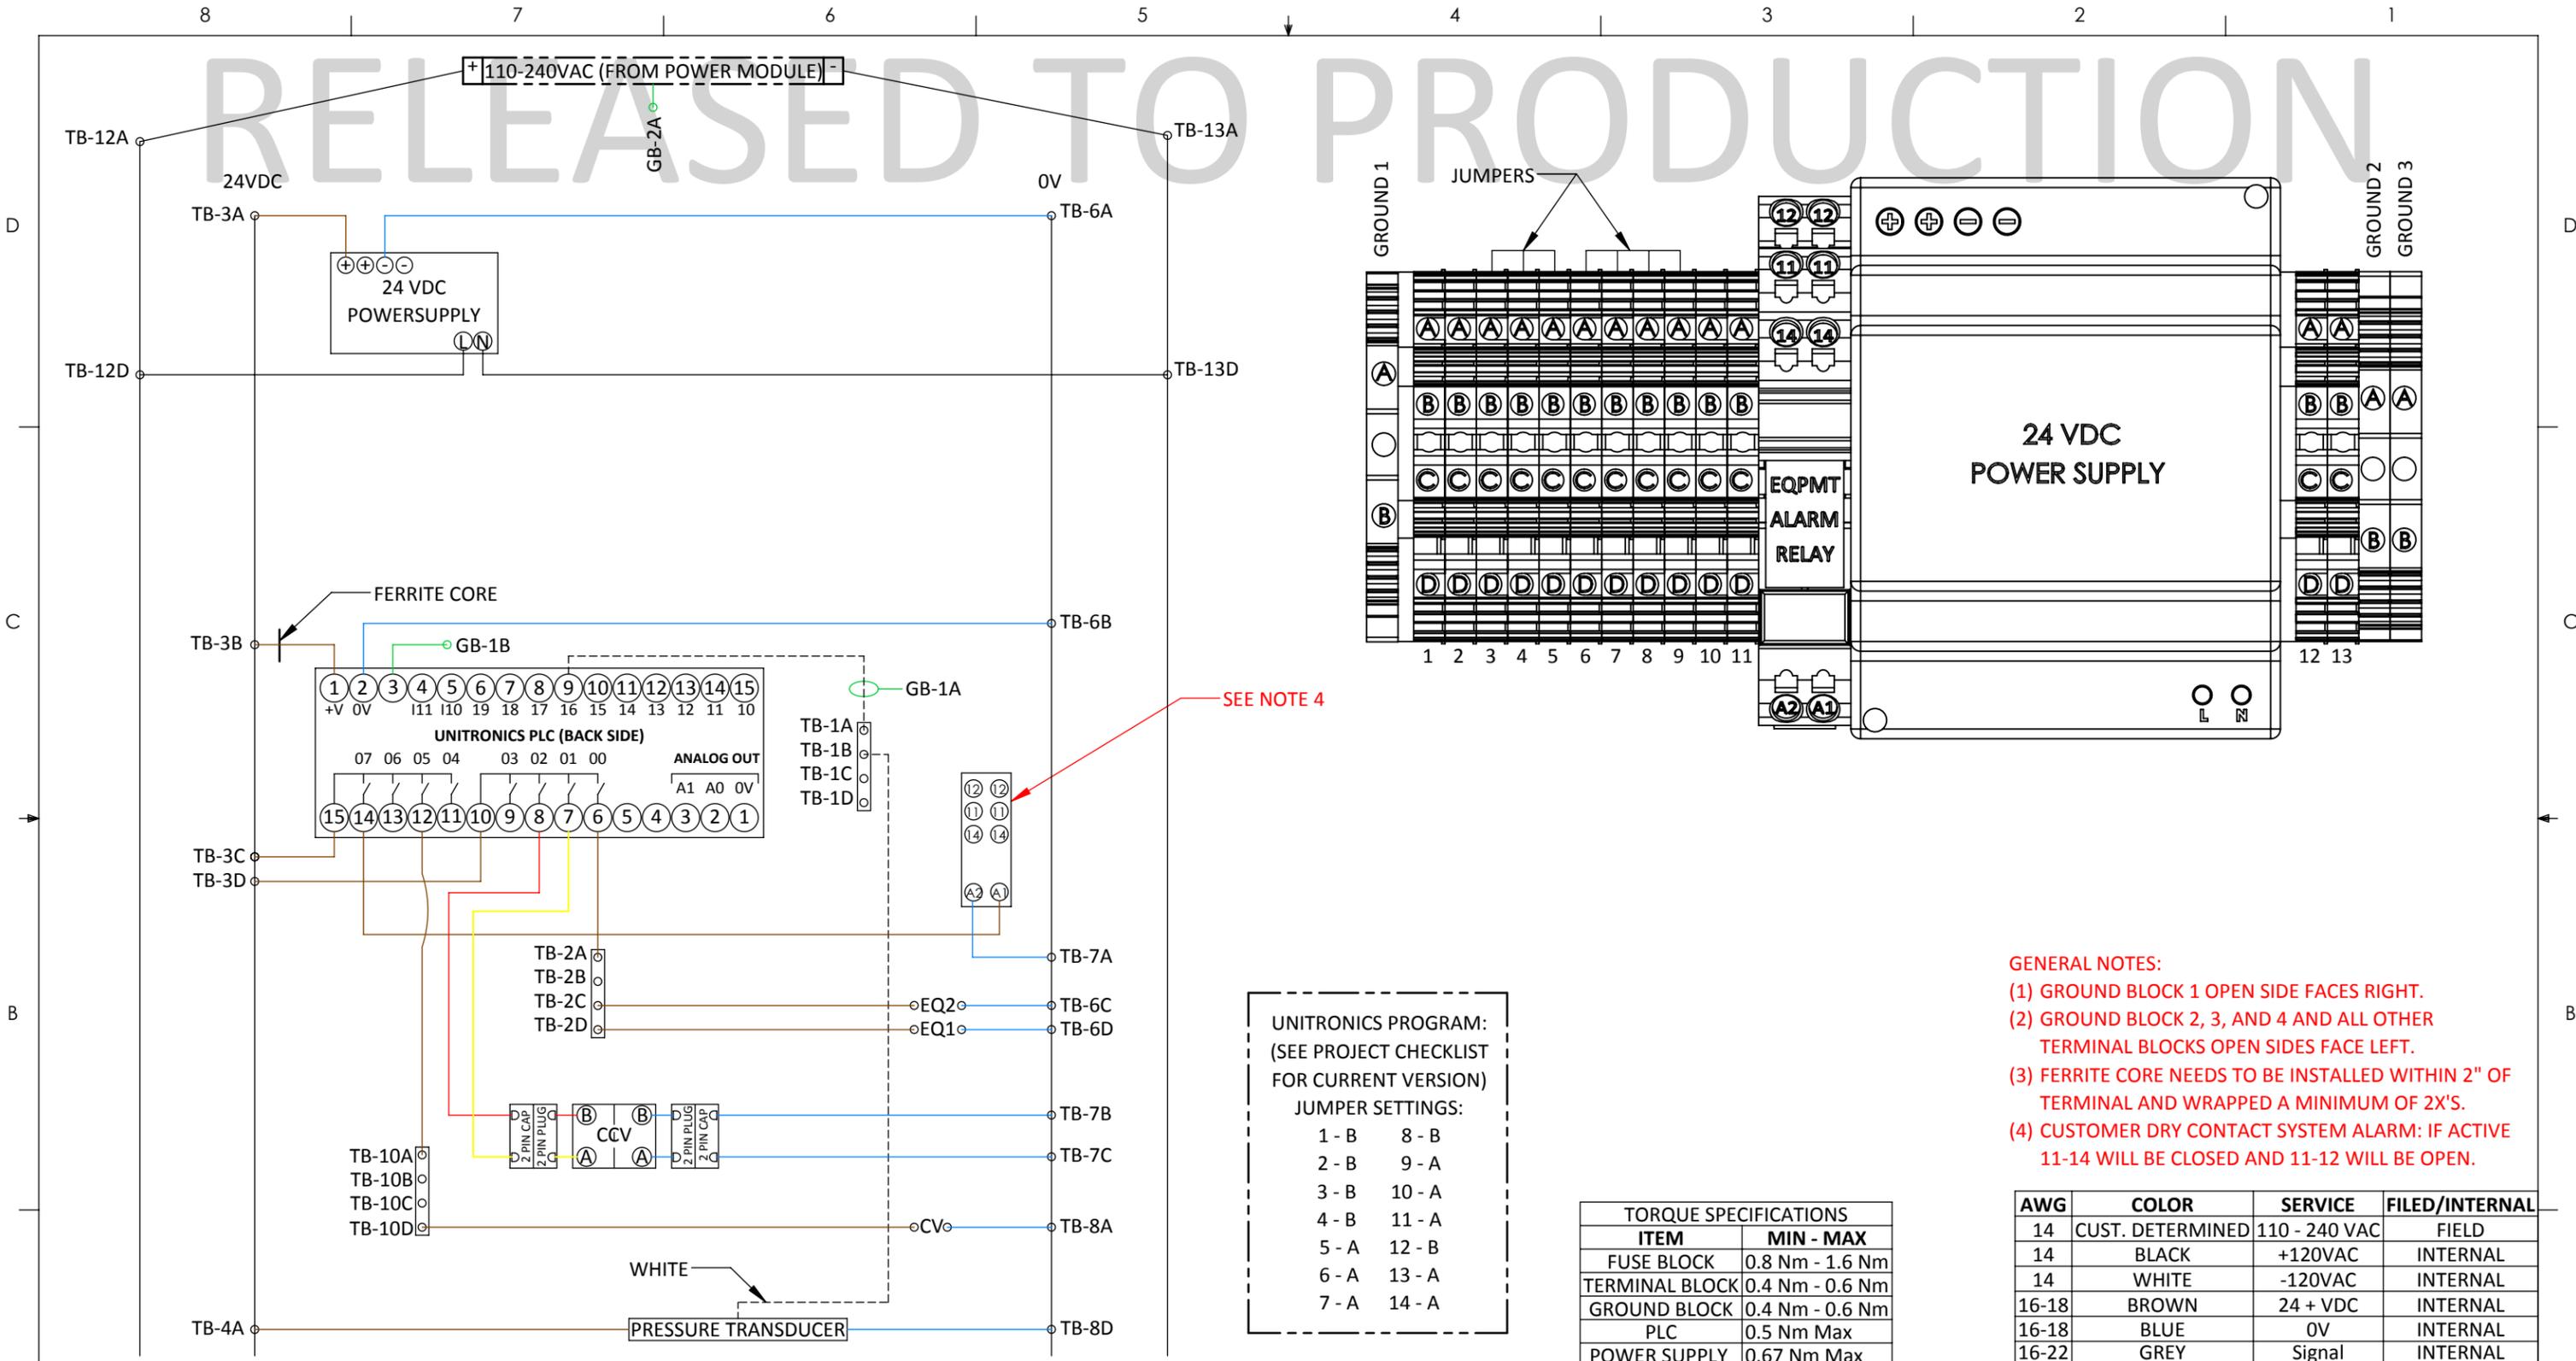

UNITRONICS PROGRAM:
(SEE PROJECT CHECKLIST FOR CURRENT VERSION)

JUMPER SETTINGS:

1 - B	8 - B
2 - B	9 - A
3 - B	10 - A
4 - B	11 - A
5 - A	12 - B
6 - A	13 - A
7 - A	14 - A

TORQUE SPECIFICATIONS	
ITEM	MIN - MAX
FUSE BLOCK	0.8 Nm - 1.6 Nm
TERMINAL BLOCK	0.4 Nm - 0.6 Nm
GROUND BLOCK	0.4 Nm - 0.6 Nm
PLC	0.5 Nm Max
POWER SUPPLY	0.67 Nm Max

- GENERAL NOTES:**
- (1) GROUND BLOCK 1 OPEN SIDE FACES RIGHT.
 - (2) GROUND BLOCK 2, 3, AND 4 AND ALL OTHER TERMINAL BLOCKS OPEN SIDES FACE LEFT.
 - (3) FERRITE CORE NEEDS TO BE INSTALLED WITHIN 2" OF TERMINAL AND WRAPPED A MINIMUM OF 2X'S.
 - (4) CUSTOMER DRY CONTACT SYSTEM ALARM: IF ACTIVE 11-14 WILL BE CLOSED AND 11-12 WILL BE OPEN.

AWG	COLOR	SERVICE	FILED/INTERNAL
14	CUST. DETERMINED	110 - 240 VAC	FIELD
14	BLACK	+120VAC	INTERNAL
14	WHITE	-120VAC	INTERNAL
16-18	BROWN	24 + VDC	INTERNAL
16-18	BLUE	0V	INTERNAL
16-22	GREY	Signal	INTERNAL

REV	TASK#	SHEET	DESCRIPTION	DATE	DRAWN	APPR.
01	10308	-	COMBINED 4CP AND FPS SCHEMATICS, ADDED RELAY AS STANDARD	02/06/18	SRG	PJS
00	10183	-	RELEASE TO PRODUCTION AFTER FIRST BUILD MARKUPS	01/26/17	PJS	JVN
A0	10183	-	RELEASE TO DEVELOPMENT. (DRAWING TAKES PLACE OF ES-CPI-PLUS)	01/13/17	PJS	JVN

REVISIONS: ONLY THE LATEST 3 REVISIONS WILL BE SHOWN. OLDER REVISIONS CONSOLIDATED AND FILED.



South-Tek Systems

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF SOUTH-TEK SYSTEMS. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF SOUTH-TEK SYSTEMS IS PROHIBITED.

MATERIAL: _____
FINISH: _____
WEIGHT: _____ **PROJECT NAME:** _____

CPI AND CPx PLUS ELECTRICAL SCHEMATIC

ELECTRICAL SCHEMATICS

NUMBER: _____ **SIZE:** B **SCALE:** 1:16 **SHEET:** 1 OF 2


ES-CP-PLUS

REVISION: **01**

DRAWN: PJS APPROVED: MRT
DATE: 01/26/17 DATE: 01/26/17

ANGLES	X.	.X	.XX	.XXX	X/X<10'	X/X>10'
±.5°	±1	±.2	±.03	±.005	±1/16	±1/8

RELEASED TO PRODUCTION

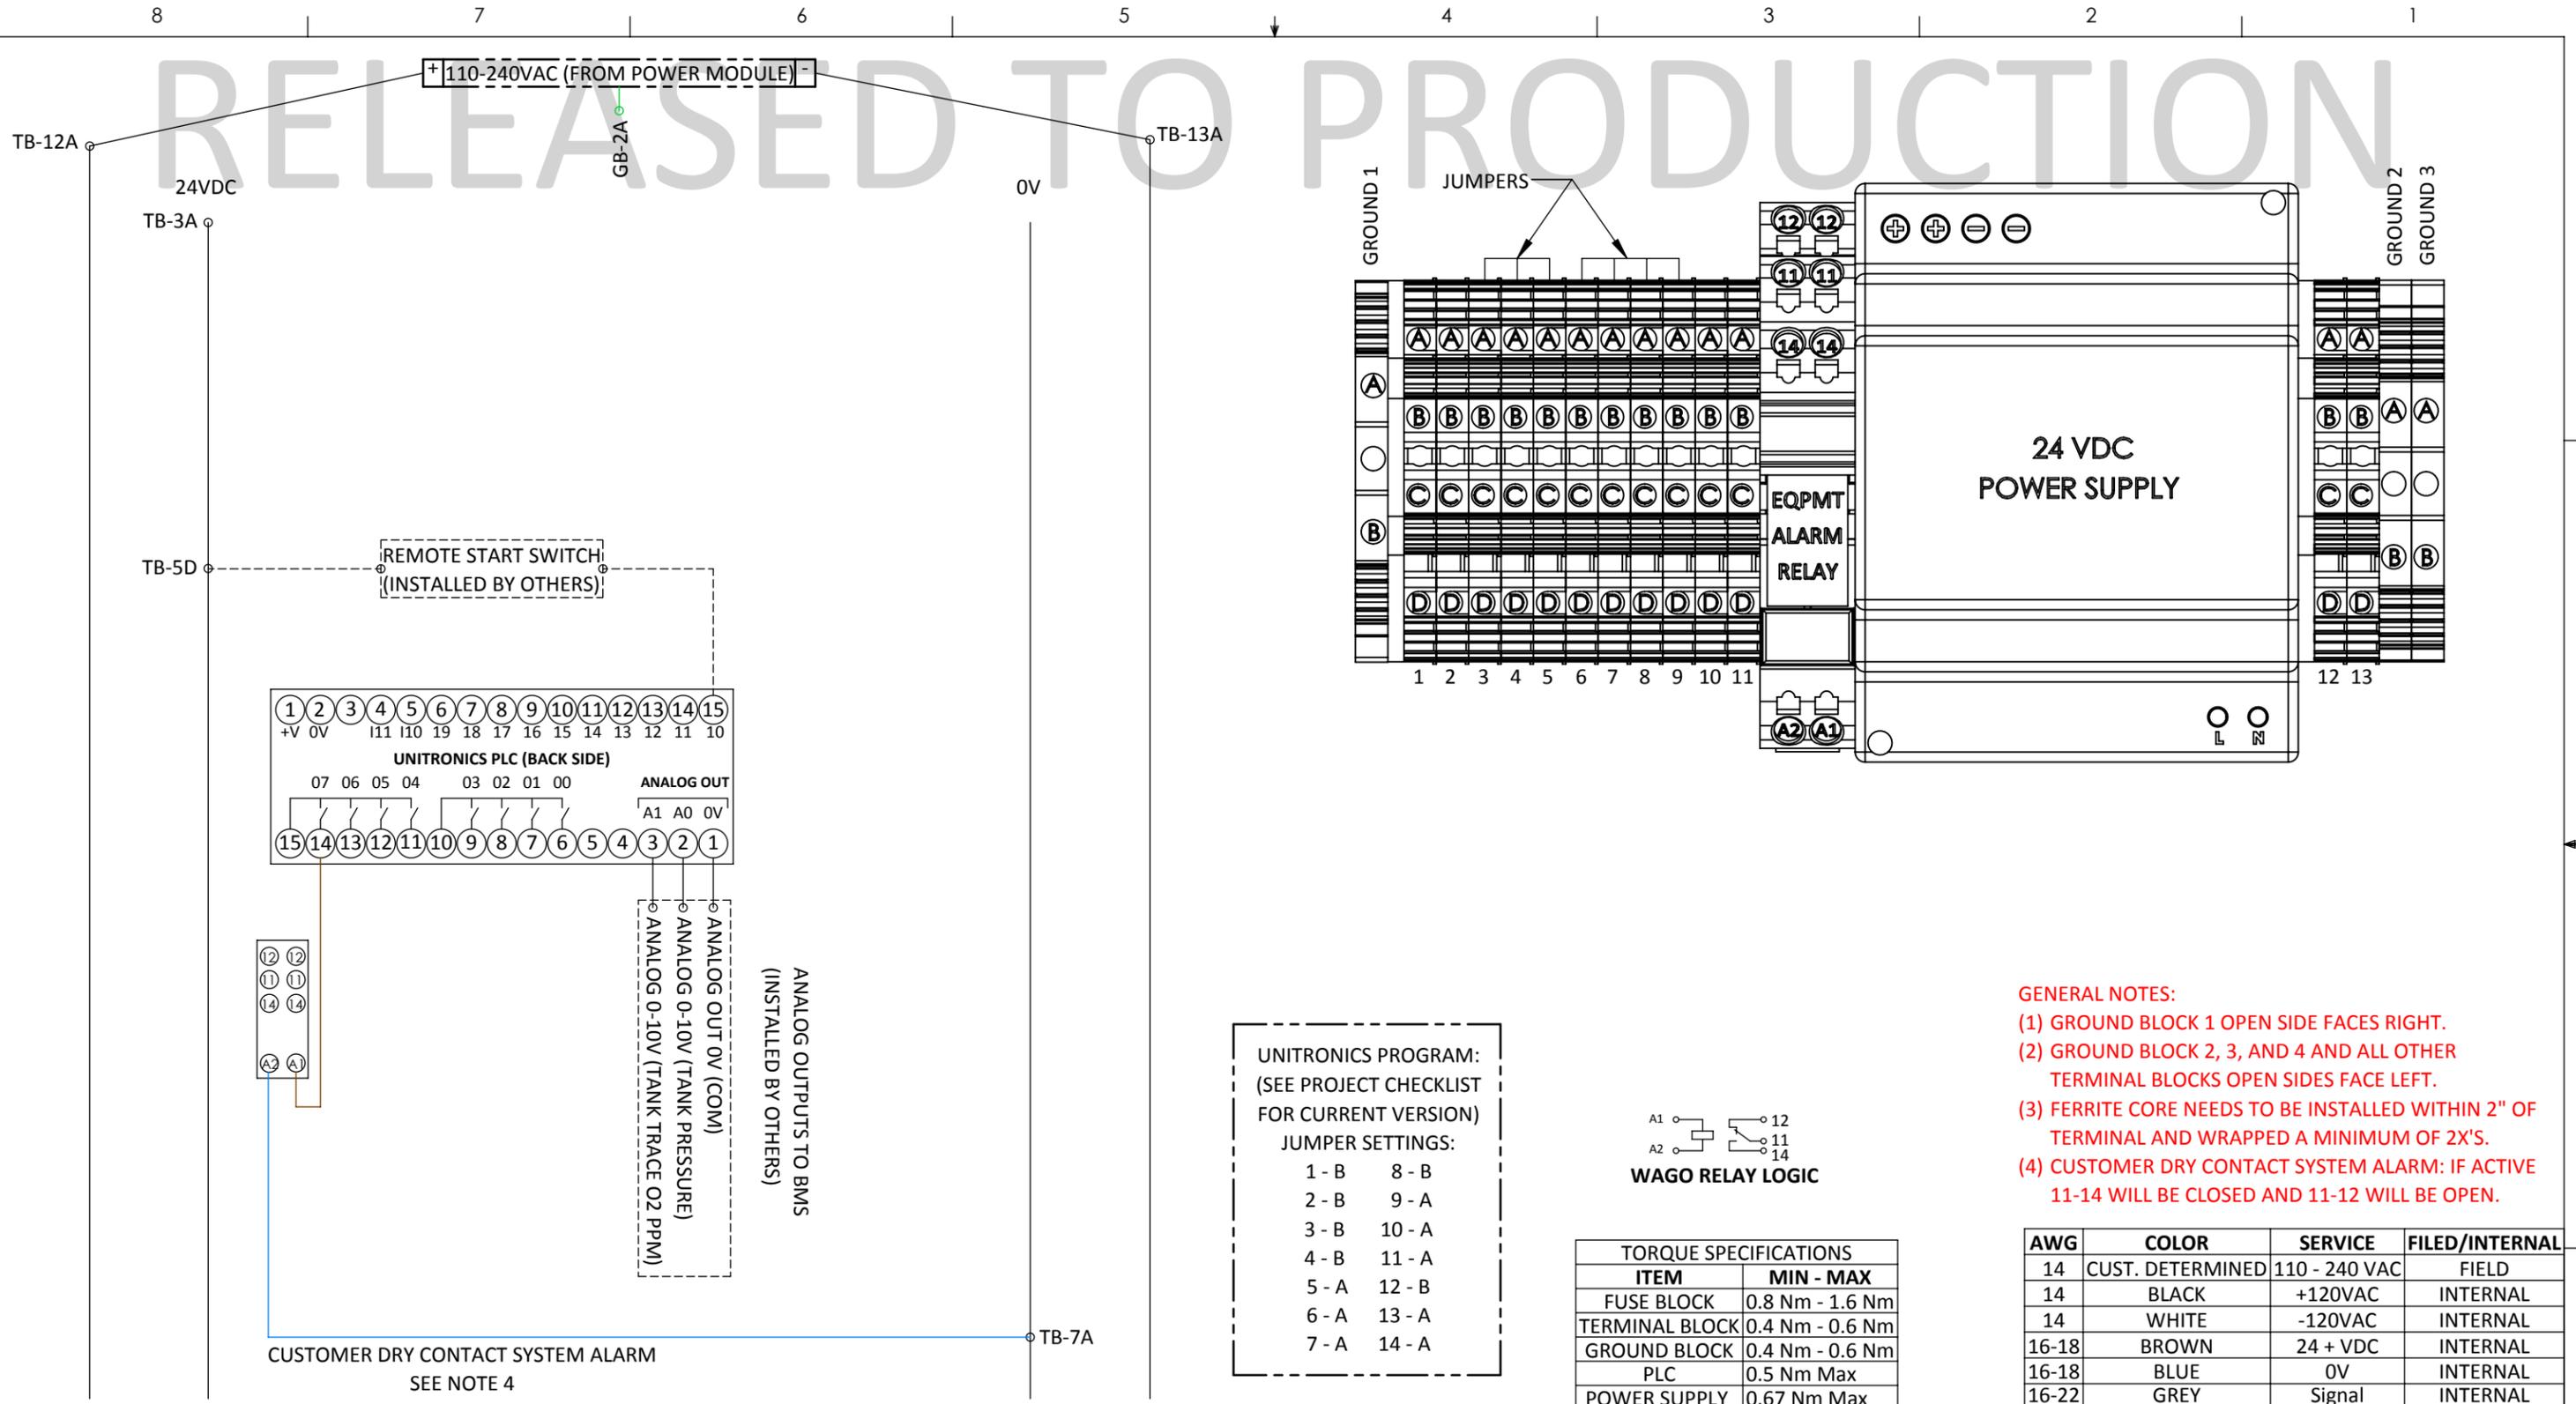

UNITRONICS PROGRAM:
(SEE PROJECT CHECKLIST FOR CURRENT VERSION)

JUMPER SETTINGS:

1 - B	8 - B
2 - B	9 - A
3 - B	10 - A
4 - B	11 - A
5 - A	12 - B
6 - A	13 - A
7 - A	14 - A



TORQUE SPECIFICATIONS	
ITEM	MIN - MAX
FUSE BLOCK	0.8 Nm - 1.6 Nm
TERMINAL BLOCK	0.4 Nm - 0.6 Nm
GROUND BLOCK	0.4 Nm - 0.6 Nm
PLC	0.5 Nm Max
POWER SUPPLY	0.67 Nm Max

- GENERAL NOTES:**
- (1) GROUND BLOCK 1 OPEN SIDE FACES RIGHT.
 - (2) GROUND BLOCK 2, 3, AND 4 AND ALL OTHER TERMINAL BLOCKS OPEN SIDES FACE LEFT.
 - (3) FERRITE CORE NEEDS TO BE INSTALLED WITHIN 2" OF TERMINAL AND WRAPPED A MINIMUM OF 2X'S.
 - (4) CUSTOMER DRY CONTACT SYSTEM ALARM: IF ACTIVE 11-14 WILL BE CLOSED AND 11-12 WILL BE OPEN.

AWG	COLOR	SERVICE	FILED/INTERNAL
14	CUST. DETERMINED	110 - 240 VAC	FIELD
14	BLACK	+120VAC	INTERNAL
14	WHITE	-120VAC	INTERNAL
16-18	BROWN	24 + VDC	INTERNAL
16-18	BLUE	0V	INTERNAL
16-22	GREY	Signal	INTERNAL

REV	TASK#	SHEET	DESCRIPTION	DATE	DRAWN	APPR.
01	10308	-	COMBINED 4CP AND FPS SCHEMATICS, ADDED RELAY AS STANDARD	02/06/18	SRG	PJS
00	10183	-	RELEASE TO PRODUCTION AFTER FIRST BUILD MARKUPS	01/26/17	PJS	JVN
A0	10183	-	RELEASE TO DEVELOPMENT. (DRAWING TAKES PLACE OF ES-CPI-PLUS)	01/13/17	PJS	JVN

REVISIONS: ONLY THE LATEST 3 REVISIONS WILL BE SHOWN. OLDER REVISIONS CONSOLIDATED AND FILED.



PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF SOUTH-TEK SYSTEMS. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF SOUTH-TEK SYSTEMS IS PROHIBITED.

MATERIAL:		CPI AND CPx PLUS ELECTRICAL SCHEMATIC		DRAWN: PJS	APPROVED: MRT	
FINISH:				DATE: 01/26/17	DATE: 01/26/17	
WEIGHT:		PROJECT NAME: ELECTRICAL SCHEMATICS	SIZE: B	SCALE: 1:16	SHEET: 2 OF 2	
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES		NUMBER: ES-CP-PLUS		REVISION: 01		
ANGLES	X.	.X	.XX	.XXX	X/X<10'	X/X>10'
±.5°	±1	±.2	±.03	±.005	±1/16	±1/8